

## Technical data

Roofing tile	NIBRA® flat tile S 9
Manufacturer	Nelskamp (D)
Overall length	~ 49.4 cm
Overall width	~ 29.2 cm
Covering length	~ 33.0 - 40.0 cm
Mean covering width	~ 26.8 cm
Requirement per m <sup>2</sup>	~ 9.2 pieces
Weight per tile	~ 4.3 kg
Weight per m <sup>2</sup>	~ 39.5 kg
Regular roof pitch	35°
Laths	30 x 50 mm
Recommended storm clip	435/105
Laths	40 x 60 mm
Recommended storm clip	435/106



## The Colours

natural red, red engobed, old colours engobed

## Laying!

The following applies when laying our clay roof tiles:

1. The NELSKAMP manufacturer's instructions take priority (laying instructions)
2. The specialist rules of the roofing trade (rules for coverings with clay roof tiles)
3. The German Construction Contract Procedures (VOB) (clay roof tile cover)

## Material requirements for coverage

Laths	~ 3.3 m <sup>2</sup> (incl. 10% waste)
Counter-laths	~ 1.7 m <sup>2</sup> (incl. 10% waste)
Roof tile	~ 9.2 pieces/m <sup>2</sup>
Packing unit*	
Tiles per pallet	264 pieces
Tiles per stack	33 pieces
Half tile	individual
Double flap	~ 2.6 pieces/m for left side of roof only
Verge tile	~ 2.6 pieces/m
Walking grid pantile	as required
Safety step pantile	as required
Ridge or crest tile	~ 2.6 pieces/m
Copper roll/Alu roll 2000 (5 m per roll)	as required
Ridge/crest clip 470/41	1.0 piece per ridge tile standard
Ridge/crest clip 470/166	1.0 piece per ridge tile square
Wood screws	1.0 piece per ridge tile d = 4.5 mm Screw depth: 24 mm
Ridge or crest initial tile	1.0 piece per ridge or crest start
Ridge end tile	1.0 piece per ridge end
Ridge lath holder	1.0 piece per rafter
Crest lath holder	1.0 piece/ ~ 70 cm
Eaves fresh air element	~ 1.1 piece/m Fresh air ~ 200 cm <sup>2</sup> /m

\* only applies for deliveries in Germany


## Storm clips



No. 435/105 for laths 30 x 50 V2A  
No. 435/106 for laths 40 x 60 V2A

According to professional standards, we can supply storm clips for a simple and effective protection against wind suction. They can alternatively be clipped to the laths or knocked into the laths. Resistant to corrosion through stainless steel wire 1.4301 (A2) or ZIAL® coating (corrosion protection).

## Covering widths

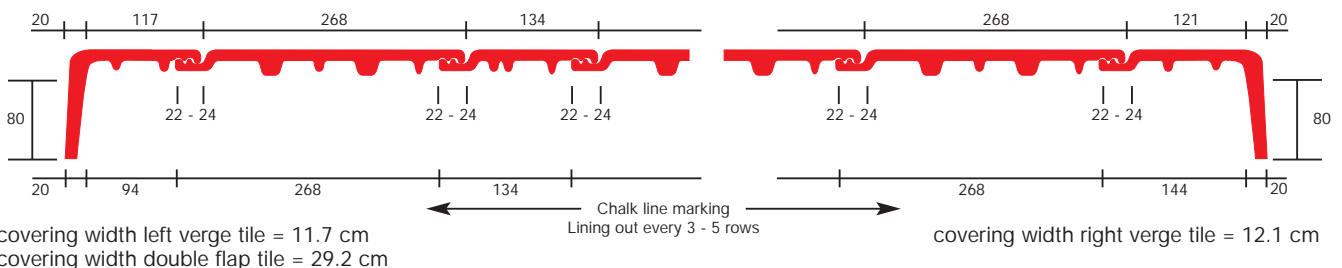

**Classification of additional measures except for subordinate buildings <sup>1)</sup> according to the technical rules of the German roofing trade, last revised January 2010**

Roof pitch	Higher requirements <sup>2)</sup>			
	Use - Design - Climatic conditions			
	no further increased requirement <sup>2)</sup>	one further increased requirement <sup>2)</sup>	two further increased requirement <sup>2)</sup>	three further increased requirement <sup>2)</sup>
≥ 35°	<b>Class 6</b> 3.3 Underlayment (USB- A) <sup>4)</sup>	<b>Class 6</b> 3.3 Underlayment (USB- A) <sup>4)</sup>	<b>Class 5</b> 2.4 Overlapping / interlocking undercover (UDB- A; UDB- B <sup>5)</sup> ; USB- A) <sup>4)</sup>	<b>Class 4</b> 2.2 Welded / bonded undercover 2.3 Undercover covered with bitumen sheeting 3.2 Underlayment secured at seams (UDB- A; UDB- B <sup>5)</sup> ; USB- A) <sup>4)</sup>
≥ 31°	<b>Class 4</b> 2.2 Welded / bonded undercover 2.3 Undercover covered with bitumen sheeting 3.2 Underlayment secured at seams (UDB- A; UDB- B <sup>5)</sup> ; USB- A) <sup>4)</sup>	<b>Class 4</b> 2.2 Welded / bonded undercover 2.3 Undercover covered with bitumen sheeting 3.2 Underlayment secured at seams (UDB- A; UDB- B <sup>5)</sup> ; USB- A) <sup>4)</sup>	<b>Class 3</b> 2.1 Undercover secured at seams and perforations 3.1 Underlayment secured at seams and perforations (UDB- A; UDB- B <sup>5)</sup> ; USB- A) <sup>4)</sup>	<b>Class 3</b> 2.1 Undercover secured at seams and perforations 3.1 Underlayment secured at seams and perforations (UDB- A; UDB- B <sup>5)</sup> ; USB- A) <sup>4)</sup>
≥ 27°	<b>Class 3</b> 2.1 Undercover secured at seams and perforations 3.1 Underlayment secured at seams and perforations (UDB- A; UDB- B <sup>5)</sup> ; USB- A) <sup>4)</sup>	<b>Class 3</b> 2.1 Undercover secured at seams and perforations 3.1 Underlayment secured at seams and perforations (UDB- A; UDB- B <sup>5)</sup> ; USB- A) <sup>4)</sup>	<b>Class 3</b> 2.1 Undercover secured at seams and perforations 3.1 Underlayment secured at seams and perforations (UDB- A; UDB- B <sup>5)</sup> ; USB- A) <sup>4)</sup>	<b>Class 3</b> <sup>3)</sup> 2.1 Undercover secured at seams and perforations 3.1 Underlayment secured at seams and perforations (UDB- A; UDB- B <sup>5)</sup> ; USB- A) <sup>4)</sup>
≥ 23°	<b>Class 2</b> 1.2 Rainproof roof substructure	<b>Class 2</b> 1.2 Rainproof roof substructure	<b>Class 1</b> 1.1 Waterproof roof substructure	<b>Class 1</b> 1.1 Waterproof roof substructure
≥ 10°	<b>Class 1</b> 1.1 Waterproof roof substructure	<b>Class 1</b> 1.1 Waterproof roof substructure	<b>Class 1</b> 1.1 Waterproof roof substructure	<b>Class 1</b> 1.1 Waterproof roof substructure
MRP	10°			

- 1) The additional measures named in the table are minimum measures taking into account table 1 of the "Leaflet for roof substructures, undercovers, underlays".
- 2) Higher requirements form categories in accordance with Section 1.1.3. Further higher requirements may result from the weighting within a category according to Section 1.1.3. For example, climatic conditions can lead to several higher requirements.
- 3) Only allowed if proof has been rendered of the functional reliability of the products used including accessories (sealing tapes, adhesive tapes, sealing compounds, ready-made seam protection, etc.) by the manufacturer during a driving rain test. The next highest class should otherwise be chosen.
- 4) Undercover plates are to be assigned according to the classification in the "Leaflet for roof substructures, undercovers and underlays".
- 5) If indices 2), 3), 4), 5) in the product data sheet are met:
  - 2) Resistance to driving rain, proven by the "Driving rain test underlay and undercover sheets - TU Berlin"
  - 3) Higher requirements on ageing are proven by increasing the temperature in the test method Appendix C 5.2 of DIN EN 13859- 1 to 80 °C.
  - 4) The manufacturer specifies the duration of the outdoor weathering period whilst warranting the aforementioned properties.
  - 5) The manufacturer confirms the suitability as a provisional cover and specifies the duration of the outdoor weathering period whilst warranting the aforementioned properties.

**Roof lathing in conjunction with ridge flaps (dry ridge)**

**Supporting laths:**


The following min. cross-sections must be used:  
(rules for roofing, notes on wood and timber materials)

Nom. cross-sections of support laths	Rafter intervals (unit spacing)	Sizing class
30 x 50 mm	≤ 80 cm	S 10
40 x 60 mm	≤ 100 cm	S 10

**Counter-laths:**

Rec. thickness of counter-laths acc. to rules for roofing  
(notes on wood and timber materials):


Rafter length	Rec. thickness
up to 8 m	24 mm
up to 12 m	30 mm
over 12 m	40 mm

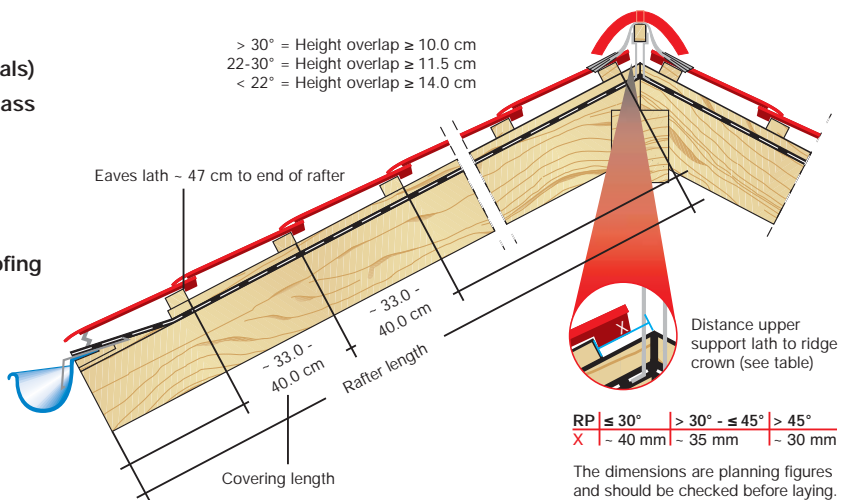

**Details eaves design**


The dimensions are planning figures and should be checked before laying depending on the design and local circumstances.

**1 With gutter & vent element**

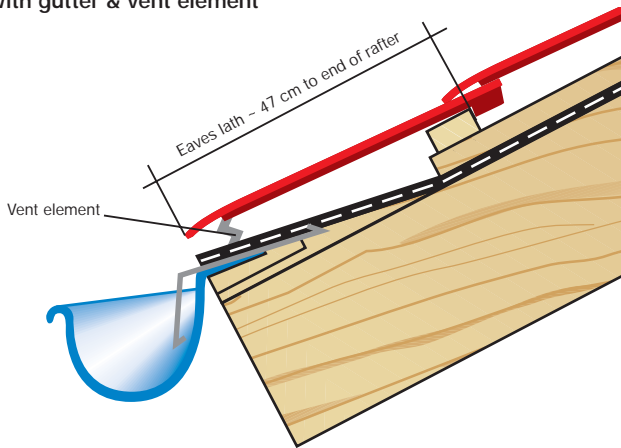


**2 High-level gutter (recommended for flat roof pitches < 22°)**


Tile overhang in gutter max. 1/3 of gutter width

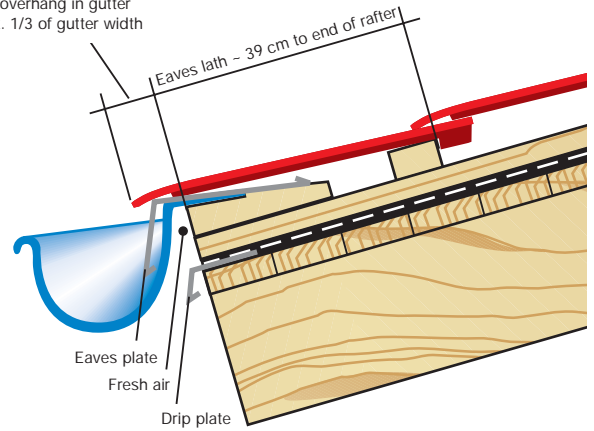

**Ridge/crest details**

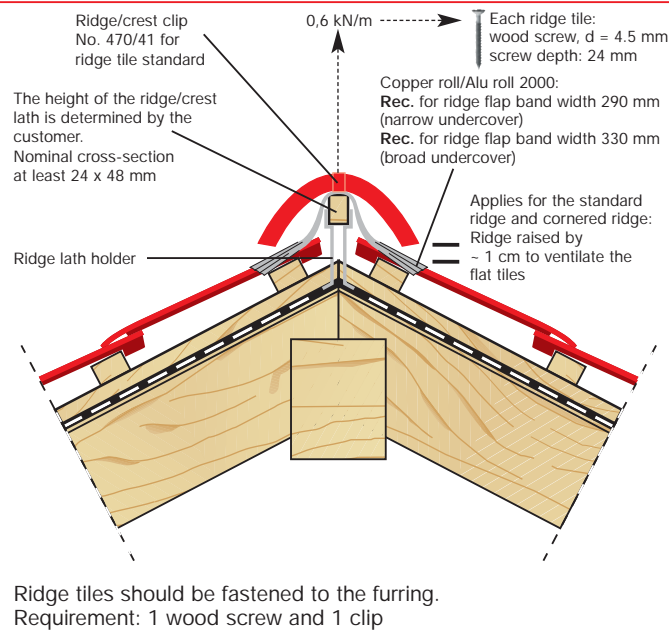

**Verge details**

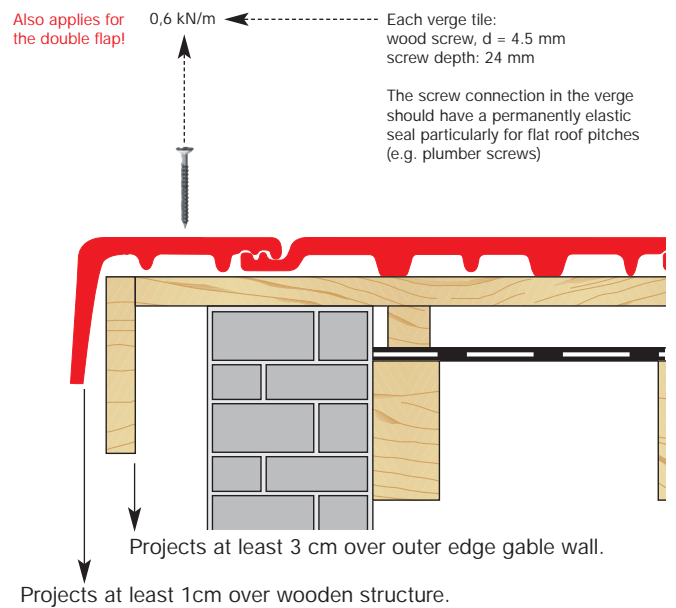


**Installation instructions for safety step tile/ walking grid tile/snow stop tile**

Every safety step tile/walking grid tile must be provided with an additional supporting-safety lath (same lath cross-section as supporting laths). **Fastening to supporting lath:** two corrosion-proof wood screws (4.5 x 45 mm per tile)

Processing acc. to DIN 18160-5

Article	≤ 45°	> 45°
Walking grid tile	every row of tiles	every row of tiles
Safety step tile	every row of tiles	every row of tiles

tested to DIN EN 516

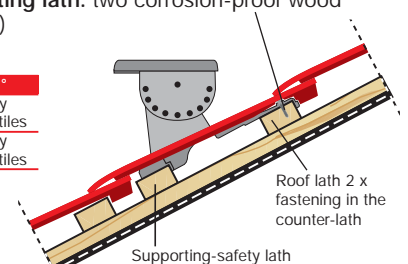


The same applies for interlocking tiles with snow rib or round wood holder, whereby the max. support spacing should not exceed 90 cm. For higher demands you should reduce the support spacing (60 cm).

## Shed roof tile

Shed roof tiles should be fastened to the furring (see detail verge).

Size sheets can be downloaded from the Internet or on the data service CD

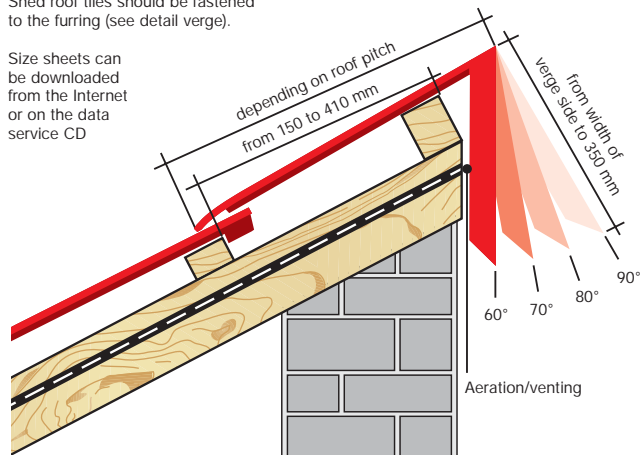

90°

- maximum lath size of 410 mm
- minimum lath size of 150 mm

80° = RP 10°

- maximum lath size of 380 mm
- minimum lath size of 150 mm

70° = RP 20°


- maximum lath size of 365 mm
- minimum lath size of 150 mm

60° = RP 30°

- maximum lath size of 360 mm
- minimum lath size of 150 mm

## Aeration and ventilation in steep roof

- 1 Eaves fresh air element
- 2 Copper roll/Alu roll 2000
- 3 Clay dormer ventilator with fitted screen  
vent cross-section  
~ 20 cm<sup>2</sup>

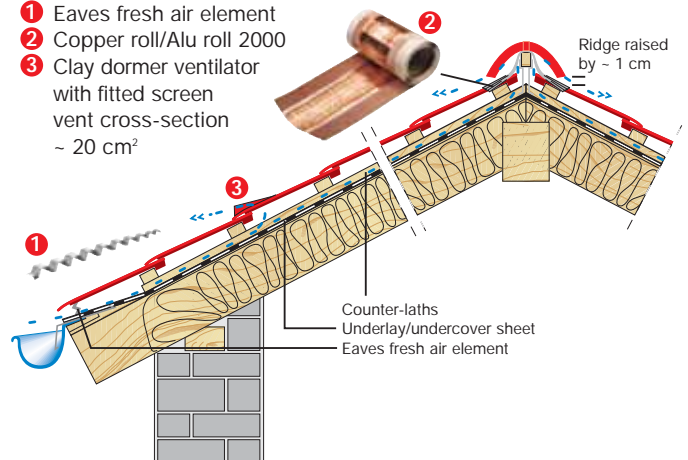

- 1) The vent cross-section at the eaves should be at least 200 cm<sup>2</sup>/m of eaves.
- 2) The vent cross-section at the ridge or crest should be at least 0.5% of the total corresponding roof area, though at least 50 cm<sup>2</sup>.

(according to DIN 4108-3)